



Life cycle environmental impacts of electricity from fossil fuels in Chile over a ten-year period

Carlos Gaete-Morales^{a, b}, Alejandro Gallego-Schmid^{a, c}, Laurence Stamford^a, Adisa Azapagic^{a, *}

^a Sustainable Industrial Systems, School of Chemical Engineering and Analytical Science, University of Manchester, The Mill, Sackville Street, Manchester, M13 9PL, UK

^b Department of Energy, Transportation and Environment, German Institute for Economic Research (DIW Berlin), Mohrenstraße 58, Berlin, 10117, Germany

^c Tyndall Centre for Climate Change Research, School of Mechanical, Aerospace and Civil Engineering, The University of Manchester, HG1, Pariser Building, Sackville Street, Manchester, M13 9PL, UK

ARTICLE INFO

Article history:

Received 8 November 2018

Received in revised form

27 May 2019

Accepted 30 May 2019

Available online 1 June 2019

Keywords:

Climate change

Power generation

Coal

Oil

Gas

Life cycle assessment

ABSTRACT

This study uses life cycle assessment to evaluate the environmental impacts of electricity generated from fossil fuels in Chile over a ten-year period, from 2004 to 2014. The focus on fossil fuels is highly relevant for Chile because around 60% of electricity currently comes from natural gas, coal and oil. The impacts are first considered at the level of individual technologies, followed by the evaluation of the fossil-fuel electricity mix over the period. The study has been carried out using detailed primary data for 94 operating plants. Considering individual technologies, coal power has the worst performance for eight out of 11 impacts, with eutrophication, freshwater and marine ecotoxicity being between ten and 240 times greater than for gas. However, oil is worse than coal for photochemical oxidants (31%) and depletion of elements and ozone layer (four and eight times, respectively). Between 2004 and 2014, the annual environmental impacts doubled, while electricity generation rose only by 55%. The only exception to this is ozone depletion which fell by around 4%. The highest impacts occurred in 2014 mainly because of the high contribution of coal power. Therefore, the environmental performance of fossil-based electricity in Chile has worsened over time due to the growing share of coal power, coupled with the increasing electricity demand. Consequently, policy should aim to increase the efficiency of power plants, avoid the use of petroleum coke, improve emissions control and replace coal and oil with gas power as soon as possible.

© 2019 Elsevier Ltd. All rights reserved.

1. Introduction

Historically, the electricity in Chile was mainly supplied by hydropower (International Energy Agency, 2009). However, since the 90s, steady economic growth has led to an increase in electricity consumption, which has been growing by 7% annually (Corbo and Hurtado, 2014). Consequently, electricity demand could no longer be covered only by new hydropower installations, but had to be supplemented by coal, natural gas and oil power (International Energy Agency, 2009, 2014; Raineri, 2006). As can be seen in Fig. 1, this trend has continued over the years and nowadays the majority of electricity is generated from fossil fuels (60%) (Bartos

and Robertson, 2014; CNE, 2015a; Ministry of Energy of Chile, 2014a). In total, 94 power plants are in operation in Chile: 19 coal, four gas, 60 oil and 11 dual-fuel (oil and gas) installations. Their total installed capacity is 10.4 GW, comprising the following technologies (Fig. 2): circulating fluidised bed (4%), pulverised coal (36%), combined cycle (32%), open cycle (20%) and diesel engine (8%).

In terms of electricity generation from fossil fuels, coal contributes 69%, natural gas 24% and oil 7% (CNE, 2015a). As Chile has low reserves of fossil fuels, the majority of fuels are imported (Bartos and Robertson, 2014; Ministry of Energy of Chile, 2014a). A growing number of studies are reporting a significant potential of renewable energies (PRIEN-UTFSM, 2008; Santana et al., 2014; Sims, 2011) which could gradually substitute fossil fuels. However, in the case of hydropower, which is still a significant contributor to power generation in Chile (34%), the major difficulty in continuing

* Corresponding author.

E-mail address: adisa.azapagic@manchester.ac.uk (A. Azapagic).

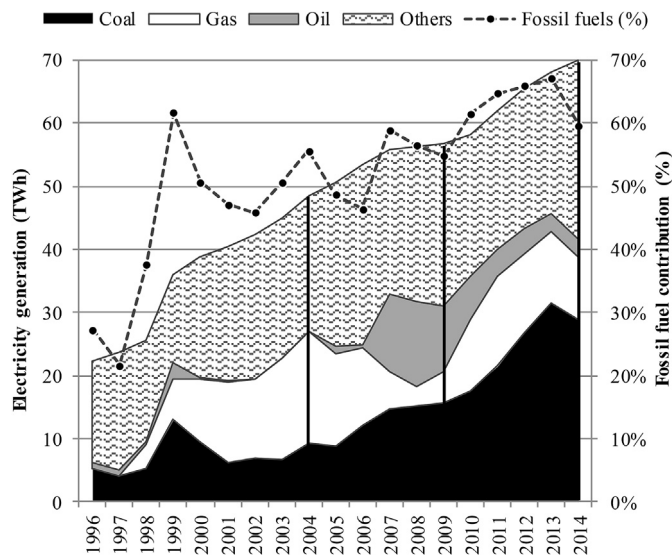


Fig. 1. Electricity generation in Chile by source and contribution of fossil fuel in the period 1996–2014. [Vertical black lines denote the years chosen for the assessment in this study (2004, 2009 and 2014) (CISEN, 2016; CNE, 2015a)].

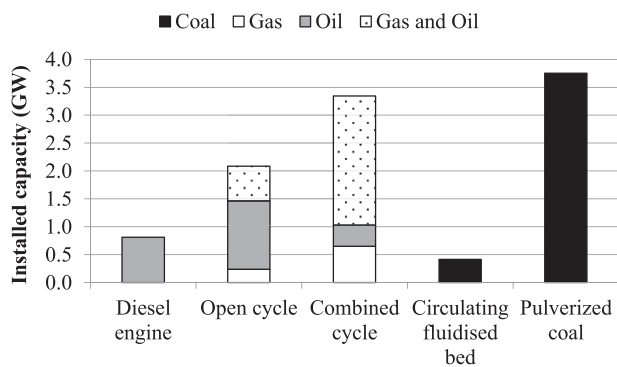


Fig. 2. Current installed capacity in Chile by technology and fuel (CNE, 2015b).

its development is the social opposition (Bronfman et al., 2012). Therefore, the government is implementing measures for the deployment of other renewable energy sources, such as solar, wind and geothermal (Ministry of Energy of Chile, 2013; 2014b). However, the contribution of these technologies is still low (~5%) (Ministry of Energy of Chile, 2015). Therefore, in the medium term, fossil fuels will continue to contribute significantly to the electricity generation profile of Chile.

Globally, electricity has been by far the most important source of anthropogenic CO₂ emissions since the 1970s (UN Intergovernmental Panel on Climate Change, 2007) contributing to climate change, and Chile is no exception (International Energy Agency, 2009). As a result of a high contribution of fossil fuels to the electricity generation, the electricity sector emitted 30% of the total national greenhouse gas (GHG) emissions in 2010, equating to 27 Mt of CO₂ eq. (Ministry of Environment of Chile, 2014). This is equivalent to 0.09% of global GHG emissions. The Chilean government has committed to reducing GHG emissions per unit of GDP by 30% by 2030, relative to 2007 (Ministry of Environment of Chile, 2015). However, at present there is scant information on the contribution of fossil-fuel electricity to the GHG emissions on a life cycle basis, with other life cycle impacts being also largely

unknown. Although two recent studies estimated life cycle impacts of electricity in Chile (Gaete-Morales et al., 2018; Vega-Coloma and Zaror, 2018), they both considered the whole electricity sector rather than focusing on the fossil-fuel sources. A similar situation is found for other countries, in which life cycle assessment studies (LCA) have been carried out for the whole sector (Garcia et al., 2014; Santoyo-Castelazo et al., 2011; Stamford and Azapagic, 2012). Therefore, this paper focuses of fossil-fuel power in Chile in an attempt to provide comprehensive information on its environmental impacts and inform policy. The impacts are estimated through LCA for each technology as well as for the fossil-fuel electricity mix. A temporal evolution of the impacts over a ten-year period (2004–2014) is also considered to determine how the impacts may have changed and why. The study relies on real data from the 94 plants currently operating in Chile. These are detailed in the next section, together with methods and assumptions used in the study.

2. Methods

The LCA study has been carried out following the ISO 14040 and ISO 14044 standards (International Organization for Standardization, 2006a, 2006b), with the goal and scope defined next, followed by the inventory data and impacts considered in this work.

2.1. Goal and scope definition

The main goal of the study is to estimate the life cycle environmental impacts of fossil-fuel electricity generation in Chile in the period from 2004 to 2014. Two functional units are considered:

- 1 kWh of electricity generated by coal, natural gas and oil power plants; and
- annual generation of electricity from these plants over the ten-year period.

As illustrated in Fig. 3, the scope of the study is from 'cradle to grave'. The following stages are included: extraction, transport and processing of fossil fuels, power plant construction, operation and decommissioning, and end-of-life waste management. Transmission, distribution and use of electricity are outside the system boundaries as the focus is on generation.

2.2. Inventory data and assumptions

The study considers plants within two major electricity transmission systems in Chile: the Interconnected System of Norte Grande (SING) and Central Interconnected System (SIC). Collectively, these two systems supply 98% of national electricity consumption (CNE, 2015a).

Primary data have been sourced from the National Energy Commission (CNE), the Energy Ministry, National Service of Geology and Mining (SERNAGEOMIN), Environmental Protection Agency (SMA) and the SING and SIC load dispatch centres (CDEC-SING and CDEC-SIC). Additional information has been obtained from other institutional reports and academic literature as detailed below. The background data have been sourced from Ecoinvent 2.2 (Ecoinvent, 2010). These have been adapted to reflect Chilean conditions as follows:

- power plant combustion by using specific input flows and calorific values of fuels as well as the capacity factors and life-spans of the plants;

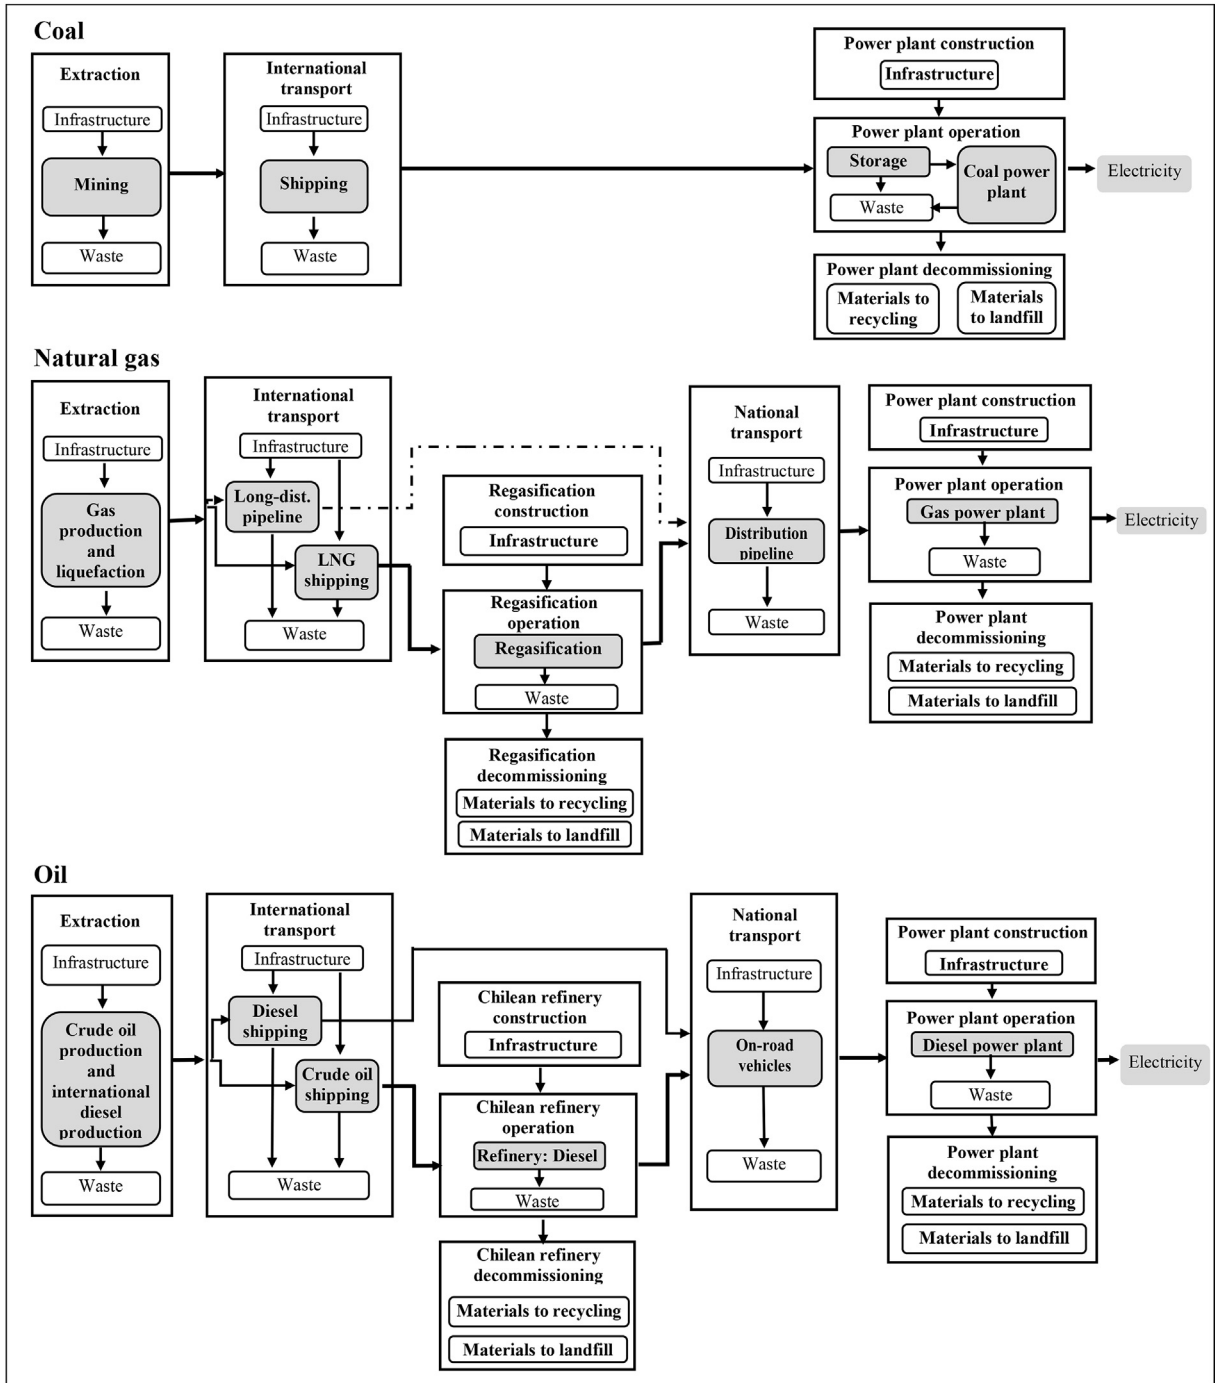


Fig. 3. The life cycle of coal, gas and oil electricity from cradle to grave. [Dashed lines represent processes that took place only in 2004. LNG: liquefied natural gas].

- power plant construction by adding the recycling rates at the end of life; and
- regional storage of fuel by adding input flows of each fuel-importing country and mass-weighted distances (t.km) for these countries.

2.2.1. Current situation: fuel supply and power plants

The base year chosen for the study is 2014, the most recent year for which detailed power plant data have been available. Total generation of fossil-based electricity in 2014 was 41,634 GWh, of which coal contributed 69%, gas 24% and oil 7%. Detailed data on the coal, gas and oil power plants are provided in Tables 1-3, while an

overview of all data and assumptions can be found in Table 4. The following sections provide more detail on each type of fuel and the respective generating technologies.

2.2.1.1. Coal power plants. Coal reserves in Chile are estimated at 1.2 bn t of subbituminous coal located in the southernmost part of the country, the Magallanes region (Hackley et al., 2006). A coal mine came online in 2013 in that region, with a projected 12-year annual supply capacity of 6 Mt (SEA, 2011). At present, this covers only 14% of coal demand for electricity (Ministry of Energy of Chile, 2014a). The coal is shipped a distance of 3200 km to the coal power

Table 1
Coal power plants in Chile in the base year (CISEN, 2016; CNE, 2015a; Ministry of Energy of Chile, 2014a; SEA, 2015).

	Power plant	Type ^a	Emission control systems ^b	Installed capacity (MW)	Electricity generation (GWh)	Share (%)	Efficiency (%)
1.	CTTAR	PC	ESP - BDC	158	911	3.2%	33%
2.	CTM1 - 2	PC	ESP	341	2248	7.8%	34%
3.	CTA	CFB	ESP - NOx (Limestone)	169	1044	3.6%	36%
4.	CTH	CFB	ESP - NOx (Limestone)	170	1095	3.8%	38%
5.	CTTO U12 - 13	PC	ESP	171	1012	5.9%	29%
6.	CTTO U14 - 15	PC	ESP	269	1707	3.5%	33%
7.	CT NTO1	PC	ESP	136	1045	3.6%	36%
8.	CT NTO2	PC	—	141	1058	3.7%	36%
9.	CT ANG1 - 2	PC	ESP - SDA	545	3955	13.7%	36%
10.	CT Santa María	PC	ESP - Wet scrubber - LowNOx	370	2623	9.1%	41%
11.	CT Bocamina I	PC	ESP	130	5,08	1.8%	39%
12.	CT Ventanas 1	PC	ESP	120	7,49	2.6%	35%
13.	CT Ventanas 2	PC	ESP - LowNOx	220	1178	4.1%	36%
14.	CT N. Ventanas	PC	BDC - SDA - LowNOx	272	2183	7.6%	35%
15.	CT Campiche	PC	BDC - SDA - LowNOx	272	2156	7.5%	38%
16.	CT Guacolda 1–2 ^c	PC	ESP - BDC	304	2428	8.4%	39%
17.	CT Guacolda 3 ^c	PC	ESP - Wet scrubber - LowNOx	152	1216	4.2%	39%
18.	CT Guacolda 4	PC	ESP - LowNOx - SCR	152	1245	4.3%	39%
19.	CT Petropower ^d	CFB	BDC - NOx (Limestone)	75	530	1.8%	29%

^a PC: Pulverised coal; CFB: Circulating fluidised bed.

^b ESP: Electrostatic precipitator; BDC: Baghouse dust collectors; SDA: Spray dryer absorber; Wet scrubber: desulphurisation system; LowNOx: Low NOx burner; SCR: Selective catalytic reduction.

^c Petroleum coke used as secondary fuel.

^d Petroleum coke used as primary fuel.

Table 2
Natural gas power plants in Chile in the base year (CISEN, 2016; CNE, 2015a; Ministry of Energy of Chile, 2014a; SEA, 2015).

	Power plant ^a	Type ^b	Emission control systems ^c	Installed capacity (MW)	Electricity in 2014 (GWh)	Share (%)	Efficiency (%)
1.	CTM3	CC	LowNOx	250	499	5%	43%
2.	CTTO U16	CC	—	400	1460	15%	46%
3.	Gas Atacama 1	CC	LowNOx	389	28	<1%	42%
4.	San Isidro I	CC	—	379	1751	18%	45%
5.	San Isidro II	CC	—	399	2358	24%	49%
6.	Nueva Renca	CC	SCR	379	452	5%	47%
7.	Nehuenco I	CC	Wet scrubber	368	1076	11%	45%
8.	Nehuenco II	CC	Wet scrubber	398	1930	19%	49%
9.	Nehuenco III	OC	Wet scrubber	108	2	<1%	28%
10.	Taltal 1	OC	—	123	77	1%	29%
11.	Taltal 2	OC	—	122	114	1%	29%
12.	Candelaria 1	OC	Wet scrubber	136	2	<1%	28%
13.	Candelaria 2	OC	Wet scrubber	136	1	<1%	28%
14.	Quintero A	OC	LowNOx	120	97	1%	28%
15.	Quintero B	OC	LowNOx	120	150	1%	28%

^a Power plants no. 3–13 also produce electricity from oil.

^b CC: Combined cycle; OC: Open cycle.

^c Wet scrubber: desulphurisation system; LowNOx: Low NOx burner; SCR: Selective catalytic reduction.

Table 3
Oil power plants in Chile in the base year (CISEN, 2016; CNE, 2015a; Ministry of Energy of Chile, 2014a; SEA, 2015).

	Power plant ^a	Type ^b	Emission control systems ^c	Installed capacity (MW)	Electricity in 2014 (GWh)	Share (%)	Efficiency (%)
1.	Gas Atacama 1	CC	LowNOx	389	320	12%	41%
2.	Gas Atacama 2	CC	LowNOx	383	558	20%	42%
3.	San Isidro I	CC	—	379	21	1%	43%
4.	San Isidro II	CC	—	399	39	1%	46%
5.	Nueva Renca	CC	SCR	379	725	26%	46%
6.	Nehuenco I	CC	Wet scrubber	368	233	8%	50%
7.	Nehuenco II	CC	Wet scrubber	398	107	4%	50%
8.	Nehuenco III	OC	Wet scrubber	108	5	<1%	29%
9.	Taltal 1	OC	—	123	7	<1%	31%
10.	Taltal 2	OC	—	122	1	<1%	31%
11.	Candelaria 1	OC	Wet scrubber	136	7	<1%	29%
12.	Candelaria 2	OC	Wet scrubber	136	6	<1%	29%
13.	Rest of open cycle plants (24 plants) ^d	OC	—	1220	350	13%	35%
14.	Diesel engine plants (35 plants) ^d	DE	—	810	366	13%	36%

^a Power plants no. 1–12 also generate electricity from natural gas.

^b CC: Combined cycle; OC: Open cycle; DE: Diesel engine.

^c Wet scrubber: desulphurisation system; LowNOx: Low NOx burner; SCR: Selective catalytic reduction.

^d A full list can be found in Table A1 in the Appendix.

Table 4

Assumptions and summary of inventory data for the base year (CISEN, 2016; CNE, 2015f, 2015a, 2015d, 2015c; CONAMA, 2010; Ecoinvent, 2010; ENAP, 2015; International Group of Liquefied Natural Gas Importers, 2015; Ministry of Energy of Chile, 2014a; Platts McGraw Hill Financial, 2015; SEA, 2015; SMA, 2015).

Coal	Natural gas	Oil
<i>Electricity generation by fuel</i>		
- Fossil fuels share: 69%	- Fossil fuels share: 24%	- Fossil fuels share: 7%
- Plant type: pulverised coal	- Plant type: CC ^c and OC ^d	- Plant type: CC ^c , OC ^d and DE ^e
- η^a : 36%, CF ^b : 81%	- CC ^c share: 96%, η^a : 47%, CF ^b : 53%	- CC ^c share: 73%, η^a : 44%, CF ^b : 15%
- For details, see Table 1	- OC ^d power share: 4%, η^a : 28%, CF ^b : 11%	- OC ^d power share: 14%, η^a : 34%, CF ^b : 6%
	- For details, see Table 2	- DE ^e power share: 13%, η^a : 36%, CF ^b : 8%
		- For details, see Table 3
<i>Plant construction</i>		
- Lifetime: 38 years	- Lifetime: 35 years	- Lifetime: 35 years. Plants with lower capacity factors: 45 years
- Data from Ecoinvent based on average size of the plant of 460 MW	- Data from Ecoinvent based on average plant size of 400 MW and 100 MW for CC ^c and OC ^d , respectively	- Data from Ecoinvent based on average plant size of 400 MW, 100 MW and 10 MW for CC ^c , OC ^d and DE ^e , respectively
<i>Plant decommissioning</i>		
- Steel: 93% recycled. Aluminium: 43% recycled. Copper: 50% recycled. The system is credited for recycled materials		
- Concrete and plastics are not recycled. Materials not recycled are disposed in landfills		
<i>Fuel extraction and processing</i>		
- Coal: 10.7 Mt/yr	- Natural gas: 1923 MNm ³ /yr	- Diesel: 523 kt/yr
- Contribution, CV ^f :	- Contribution, CV ^f :	- Contribution:
Chile: 14%, 18.9 MJ/kg	LNG ^g : 100%, 41.1 MJ/Nm ³	Chile (refinery): 43%
Colombia: 54%, 26.8 MJ/kg	Long-dist. pipeline: 0%, 39.1 MJ/Nm ³	US (import): 57%
US: 24%, 26.0 MJ/kg	- Quintero regasification plant capacity: 5475 MNm ³	- CV ^f : 45.6 MJ/kg
Australia: 8%, 27.0 MJ/kg		
- Petroleum coke: 473 kt	- Data from Ecoinvent based on evaporation plant of average size of 42,300 MNm ³ /yr	- Crude oil with destination to refinery
- Contribution, CV ^f :	- Natural gas sales in Chile in 2014 accounted to 3317 MNm ³ processed at two terminals and distributed through 836 km of pipelines	South America: 84% (Chile:3.6%)
Chile: 42%, 32.5 MJ/kg	- Natural gas composition:	UK: 16%
US: 58%, 32.5 MJ/kg	Methane C1: 96.78%	- Chilean refinery produce 34% of diesel from crude oil processed
- Coal composition:(as received)	Ethane C2: 2.78%	- Diesel composition:
Carbon: 57.5%	Propane C3: 0.37%	Carbon: 86.1%
Hydrogen: 4.4%	Butane C4+: 0.06%	Hydrogen: 13.5%
Sulphur: 0.7%	Nitrogen: 0.01%	Sulphur: 0.4%
Oxygen: 12.5%	- LNG ^g density: 431.03 kg/m ³	- Density: 0.84 t/m ³
Nitrogen: 1.2%	- Gas density: 0.74 kg/Nm ³	
Ash: 9.7%		
Water: 14.0%		
Chlorine: 130 ppm		
Fluor: 10 ppm		
- Density: 920 kg/m ³		
<i>Transport</i>		
- Distance by ship	- Distance	- International transport by tanker
Chile: 3220 km	LNG ^g : 12,684 km	US: 8785 km (transport of diesel)
Colombia: 4585 km	Long-distance pipeline: 558 km	UK: 11,112 km (transport of crude oil to be refined in Chile)
US: 8785 km		South America: 5204 km (transport of crude oil to be refined in Chile)
Australia: 11,959 km		- Domestic transport of diesel from refinery to power plants: 664 km by lorry (28 t).

^a η : Power plant efficiency.

^b CF: Capacity factor. As capacity factors of power plants can vary significantly year by year, an average capacity factor over the past three years has been estimated for each power plant; see the Appendix.

^c CC: Combined cycle power plant.

^d OC: Open cycle power plant.

^e DE: Diesel engine power plant.

^f CV: Gross calorific value.

^g LNG: Liquefied natural gas.

plants located in the north. The rest of the coal demand is covered through the imported bituminous coal: 54% from Colombia, 24% from the US and 8% from Australia (CNE, 2015c).

Gross calorific value (CV) and composition of coal have been determined from 160 coal certificates of analysis (SMA, 2015), allowing the estimation of the average CV and coal composition by country of origin. In addition, two coal power plants used petroleum coke as secondary fuel imported from the US. One plant consumed petroleum coke as primary fuel; this plant is located in the refinery facilities in Chile and the petroleum coke is supplied by the refinery itself (ENAP, 2015). Each coal power plant has its own port and hence only the shipping between coal mines (Chilean, Colombia, US, Australia and Indonesian) and the coal power plants is considered.

The environmental burdens of petroleum coke have been obtained from Ecoinvent. As petroleum coke is co-produced with other products during crude-oil processing, allocation of the burdens has been carried out on a mass basis (Jungbluth, 2007).

The majority of coal electricity is produced in pulverised coal plants, with only a small share generated in circulating fluidised bed installations (Fig. 2). For the purposes of this study, all plants are assumed to use pulverised coal. The efficiencies of coal power plants have been obtained from CNE reports (CNE, 2015d, 2015e). Emissions of CO₂, SO₂, NO_x and particulates from coal power plants have been obtained through direct emission measurements in power plants with continuous emissions monitoring systems (CEMS) (SMA, 2015); see Table 5.

Table 5
Emission factors for coal, natural gas and oil power plants by technology^a (International Institute for Sustainability Analysis and Strategy, 2015; SMA, 2015).

Emissions	Coal plants		Natural gas plants		Oil plants	
	Pulverised coal ^a (g/MJ _{in})	Combined cycle ^a (g/MJ _{in})	Open cycle ^b (g/MJ _{in})	Combined cycle ^a (g/MJ _{in})	Open cycle ^b (g/MJ _{in})	Diesel engine ^b (g/MJ _{in})
CO ₂	97.5	61.9	56.1	88.9	80.5	75.9
NO _x	0.167	0.129	0.025	0.295	0.265	0.829
SO ₂	0.337	0.001	0.001	0.185	0.474	0.192
Particles	0.007	–	–	–	–	–

^a Determined from hourly data records from continuous emissions monitoring systems (CEMS).

^b Determined through GEMIS software considering characteristics of each plant.

2.2.1.2. Natural gas power plants. Chile covers about 20% of the total gas consumption with national reserves (Ministry of Energy of Chile, 2014a). The gas is produced in Magallanes region, but due to low production and geographical limitations for its distribution, it is just consumed by local communities. The remaining 80% of the gas demand is imported from Trinidad and Tobago as liquefied natural gas (LNG). LNG is shipped to Chile and processed in two regasification plants (CNE, 2015c). Once regasified, it is distributed through a pipeline network to the power plants. Currently, electricity generation from natural gas consumes 54% of natural gas imported (CISEN, 2016; CNE, 2015c, 2015a).

Both open and combined cycle plants are used for electricity generation from natural gas (Table 2). The efficiency of power plants has been estimated for each power plant based on the electricity produced and the amount of gas consumed (CISEN, 2016; CNE, 2015a); for details, see Table 2. Data for natural gas properties and composition are specific to LNG from Trinidad and Tobago (CNE, 2015c). Direct emissions of combined cycle plants have been estimated through CEMS records, whilst for open cycle plants, the emissions have been estimated using GEMIS 4.8 (International Institute for Sustainability Analysis and Strategy, 2015) due to a lack of primary data.

2.2.1.3. Oil power plants. Oil-fired power plants in Chile typically use diesel to produce electricity. Around 43% of the diesel is produced in Chile and the rest is imported from the US (CNE, 2015c; ENAP, 2015). Only 3% of the diesel produced in Chile is from the domestic crude oil, with the majority imported from South American countries (84%) and the UK (16%) (CNE, 2015c; Ministry of Energy of Chile, 2014a). Chile's refineries are configured to produce 34% of diesel from crude oil processed (International Energy Agency, 2012; Superintendencia de Electricidad y Combustibles de Chile, 2014). Both crude oil and diesel are transported by tanker from exporting countries to Chile for further processing and diesel is subsequently transported to power plants by trucks. The diesel composition is based on data from a Chilean refinery (ENAP, 2015).

Oil power plants use open and combined cycle as well as diesel engine. Their efficiency and direct emissions have been determined in the same way as those of natural gas plants (Table 3). For combined cycle power plants, direct emissions have been obtained through CEMS records, and for open cycle turbines and diesel engines through modelling in GEMIS.

Like petroleum coke, environmental burdens of diesel have been sourced from Ecoinvent and allocated on a mass basis relative to the other refinery co-products (Jungbluth, 2007).

2.2.2. Previous years

In addition to the base year (2014), electricity generation in years 2004 and 2009 is also considered. These two years have been chosen for the following reasons. The import of cheap natural gas from Argentina peaked in 2004, which also meant that the contribution of gas to electricity generation from fossil fuels peaked

at 65% in that year. A progressive curtailment of the imports from Argentina then occurred between 2004 and 2008, which led to difficulties in 2009, when the electricity generation deficit had to be met with diesel. This increased the share of diesel to 33% of the total generation from fossil fuels. At the same time, the share of coal power grew from 35% in 2004 to 51% in 2009. Due to the high cost of diesel, the prices of electricity increased significantly. To reduce the cost, the contribution from coal power plants continued to grow until 2014, exacerbated by a long-lasting drought which led to low generation from hydro plants (CISEN, 2016; Corbo and Hurtado, 2014; International Energy Agency, 2009). In summary, the contribution of different fuels to electricity from fossil fuels was as follows:

- 2004: coal 35%; gas 65%; oil 0%;
- 2009: coal 51%; gas 16%; oil 33%; and
- 2014: coal 69%; gas 24%; oil 7%.

The assumptions and inventory data for 2004, 2009 and 2014 are given in Table 6.

2.3. Impact assessment

The power systems have been modelled using Gabi v6.0 (PE International, 2013). The following 11 environmental impacts are considered, estimated according to the CML 2001 method (April 2015 update) (Guinée et al., 2002): abiotic depletion potential of fossil resources (ADP_{fossil}), abiotic depletion potential of elements (ADP_{elements}), eutrophication potential (EP), freshwater aquatic ecotoxicity potential (FAETP), global warming potential (GWP), human toxicity potential (HTP), marine aquatic ecotoxicity potential (MAETP), ozone layer depletion potential (ODP, steady state), photochemical oxidants creation potential (POCP), and terrestrial ecotoxicity potential (TETP). The CML methodology has been chosen to maximise comparability with prior literature on fossil-based electricity technologies in other countries, ensuring that the LCA results for Chile can be contextualised and compared with those (see Section 3.1.12).

3. Results and discussion

This section discusses first the impact per kWh of electricity generated, followed by the evolution of impacts over the ten-year period in section 3.2.

3.1. Environmental impacts of fossil-fuel technologies

The environmental impacts of electricity from coal, gas and oil, expressed per kWh and showing the contribution of different life cycle stages, are summarised Fig. 4. These results refer to the base year (2014). As can be seen, electricity generation from gas has the lowest impacts across all the impact categories. Coal is the worst option overall, with the highest values in eight out of 11 impact

Table 6
Inventory data for fossil-based electricity in Chile in 2004, 2009 and 2014.

Category	Description (unit)	2004	2009	2014
General	Total electricity generation (GWh/yr)	26,912	31,051	41,634
	Contribution of coal (%)	35%	51%	69%
	Contribution of natural gas (%)	65%	16%	24%
Coal	Contribution of oil (%)	0%	33%	7%
	Pulverised coal plant efficiency (%)	35%	36%	36%
	Coal consumption (1000 s t)	3601	4870	10,742
	Coal from Chile (%)	5%	11%	14%
	Coal from Colombia (%)	17%	66%	54%
	Coal from Indonesia (%)	23%	10%	0%
	Coal from US (%)	23%	11%	24%
	Coal from Australia (%)	32%	2%	8%
	Consumption of petroleum coke (1000 s t)	720	1289	473
	Petroleum coke from Chile (%)	19%	68%	42%
	Petroleum coke from US (%)	81%	32%	58%
	Gross calorific value of coal from Australia (MJ/kg)	21.0	25.0	27.0
	Gross calorific value of coal from Chile (MJ/kg)	18.9	18.9	18.9
	Gross calorific value of coal from Colombia (MJ/kg)	21.0	25.0	26.8
	Gross calorific value of coal from Indonesia (MJ/kg)	21.0	25.0	20.7
	Gross calorific value of coal from US (MJ/kg)	21.0	25.0	26.0
	Gross calorific value of petroleum coke (MJ/kg)	32.5	32.5	32.5
	Distance from Australia (km)	11,959	11,959	11,959
	Distance in Chile (mine to power plant) (km)	3220	3220	3220
	Distance from Colombia (km)	4585	4585	4585
	Distance from Indonesia (km)	11,959	11,959	11,959
Distance from US (km)	8785	8785	8785	
Natural gas	Contribution of combined cycle plants (%)	100%	100%	96%
	Contribution of open cycle plants (%)	0%	0%	4%
	Combined cycle plant efficiency (%)	47%	48%	47%
	Open cycle plant efficiency (%)	28%	28%	28%
	Natural gas consumption (MNm ³)	3453	920	1923
	Liquefied natural gas (%)	0%	42%	100%
	Natural gas from Argentina (%)	100%	58%	0%
Oil	Gross calorific value of gas (MJ/Nm ³)	39.1	39.9	41.1
	Contribution of combined cycle plants (%)	–	81%	73%
	Contribution of diesel engine plants (%)	–	9%	13%
	Contribution of open cycle plants (%)	–	10%	14%
	Combined cycle plant efficiency (%)	–	44%	44%
	Diesel engine plant efficiency (%)	–	36%	36%
	Open cycle plant efficiency (%)	–	34%	34%
	Diesel consumption (1000 s t)	–	1959	523
	Diesel from Chile (%)	–	45%	43%
	Diesel from US (%)	–	0%	57%
	Diesel from Korea and Japan (%)	–	55%	0%
	Distance from US (km)	–	–	8785
	Distance from Korea and Japan (km)	–	18,838	–
	Crude oil from Latin America refined in Chile (%)	–	84%	84%
	Crude oil from UK refined in Chile (%)	–	16%	16%
Gross calorific value of oil (MJ/kg)	–	45.6	45.6	

categories considered. For example, if compared with oil, coal has around 20% higher GWP and AP, four times greater HTP and 45 times higher MAETP. However, oil performs worse than coal in three impacts – POCP, ADP_{elements} and ODP – which are 31%, four and eight times higher than for coal, respectively.

The majority of the impacts are mainly due to the extraction of fossil fuels and operation of power plants. The construction and decommissioning of the plants are only significant for ADP_{elements} which can be reduced by 9%–21% across the options through recycling. These results are discussed in more detail below. Note that the total impacts incorporate the credits for material recycling while the contributions of different life cycle stages are estimated before applying the credits.

3.1.1. Abiotic depletion potential of fossil resources (ADP_{fossil})

Electricity generation from coal and oil have similar values for depletion of fossil resources (10.3 and 10.1 MJ/kWh, respectively) while the impact for gas is somewhat lower (9 MJ/kWh). These differences are associated with the efficiency of plants and calorific values of the fuels, both of which are highest for gas. Extraction of

fuels is the main contributor with a share of 96% for coal and 90% for gas and oil. The rest is related to transport, and in the case of oil, also to processing (5%).

3.1.2. Abiotic depletion potential of elements (ADP_{elements})

Oil power leads to the highest depletion of elements (123 µg Sb eq./kWh), which is four times higher than coal (30 µg Sb eq./kWh) and five times greater than gas (24 µg Sb eq./kWh). The high impact from oil is largely related to the lorry transport between the refineries and power plants. Gold and lead are the main elements depleted, associated with gold content in electronic parts of the vehicle and the use of lead for vehicle batteries (Spielmann et al., 2007).

Fuel extraction contributes 48% to coal and 40% to gas power (before the credits for recycling). The contribution from construction is also significant: 43% for gas and ~30% for coal and oil plants (all before the system credits). The high contribution of construction is attributed to the use of scarce materials within power plants and their equipment. Therefore, the recycling rates as well as the capacity factors of power plants are significant factors. For example,

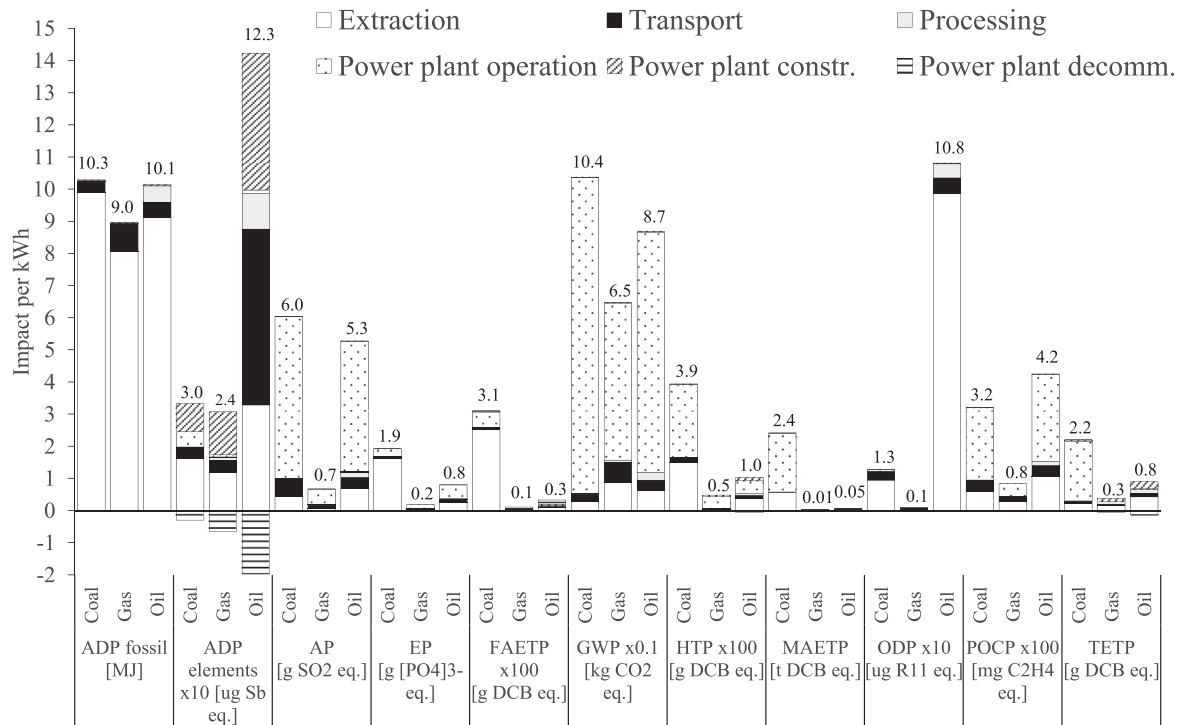


Fig. 4. Environmental impact per kWh of electricity for the base year (2014). [Values shown on top of each bar represent the net impacts, including the recycling credits. The scaled impacts should be multiplied by the factor shown in brackets for relevant categories. ADP: abiotic depletion potential, AP: acidification potential, EP: eutrophication potential, FAETP: freshwater aquatic ecotoxicity potential, GWP: global warming potential, HTP: human toxicity potential, MAETP: marine aquatic ecotoxicity potential, ODP: ozone depletion potential, POCP: photochemical oxidants creation potential, TETP: terrestrial ecotoxicity potential].

electricity from gas and oil is mostly produced in combined cycle plants, which contain scarce elements, such as chromium and copper. In addition, oil power is a peak-load technology, leading to a low capacity factor of 15%, and therefore the depletion due to construction is relatively high per unit of electricity generated. For coal power, the main cause of this impact are copper, gold, molybdenum, zinc and chromium used for explosives and metals in the mine infrastructure (Dones et al., 2007). The recycling of copper and steel, as part of the decommissioning stage, reduces the impact across the three options by 9% for coal, 21% for gas and 14% for oil.

3.1.3. Acidification potential (AP)

Coal and oil have an order of magnitude higher AP than gas: 6 and 5.3 vs 0.7 g SO₂ eq./kWh, respectively. The combustion of fuel to produce electricity is the most important process for this impact with a contribution of 84% for coal, 77% for oil and 73% for gas. Coal combustion has the highest impact because of higher emission factors (Table 5) and the lowest efficiency among the fossil fuel plants. It can also be noted that oil has a much higher impact than gas despite both fuels being predominantly used in high efficiency combined cycle plants. This is due to the SO₂ emissions from oil being 185 times higher than for gas, related to the sulphur content in oil of 0.4%. Furthermore, 13% of oil-fired power generation occurs in diesel engines which have NO_x emissions about five times higher than typical coal and gas plants. This explains why oil power, in spite of a higher efficiency (42%), has a higher AP.

3.1.4. Eutrophication potential (EP)

At 1.9 g PO₄³⁻ eq./kWh, coal has the highest EP, double that of oil (0.8 g PO₄³⁻ eq./kWh) and ten times higher than gas (0.2 g PO₄³⁻ eq./kWh). This is mainly due to mining (84%), related to the release of significant amounts of phosphate to freshwater (Dones et al., 2007). The higher impact of coal compared to the other two options is also

compounded by its lower calorific value and efficiency of the power plants, both of which increase the demand for coal per unit of electricity generated. In relation to coal mining, there are significant differences among mines in terms of environmental burdens and energy content of coal. For example, coal from Australia has 4.7 times higher environmental burdens than that from South America because Australian coal beds are typically deeper and require more energy for excavation (Dones et al., 2007; Ecoinvent, 2010). Therefore, the Australian coal causes 22% of the EP attributable to extraction, despite its contribution to the imported-coal mix of only 8%. By contrast, fuel combustion in power plants is the main contributor to the impact from gas (68%) and oil power (53%). For coal, its contribution is much lower (12%) due to a high contribution from mining compared to the other two fuels. NO_x emissions are the main cause of EP for all the power plants.

3.1.5. Freshwater aquatic ecotoxicity potential (FAETP)

Coal power is again the worst option for this impact (310 g DCB eq./kWh), with a value ten times higher than for oil (32 g DCB eq./kWh) and 28 times higher than for gas (11 g DCB eq./kWh). Mining and combustion of fuel are major hotspots for coal power (82% and 16%, respectively). Mining releases a significant amount of metals, such as nickel, beryllium, cobalt and vanadium, that contribute to freshwater ecotoxicity. Vanadium and beryllium are also released from the ash. For gas and oil, the main hotspot is plant decommissioning (37% and 45%, respectively) because of the release of copper during the scrap disposal.

3.1.6. Global warming potential (GWP)

Electricity from coal emits 1036 g CO₂ eq./kWh, while for oil and gas the GWP is equal to 868 and 646 g CO₂ eq./kWh, respectively. CO₂ emissions account for 98% of the total GHGs emitted along the life cycle of the three options. Combustion of fuels is the main

hotspot with a contribution of 95% for coal, 86% for oil and 76% for gas. In the gas life cycle, extraction and transport of LNG contribute together 23% of the impact, for which CO₂ is again the main GHG. CO₂ is emitted by machinery used for the extraction of gas, by compressors for its liquefaction and for transportation and refrigeration of LNG.

3.1.7. Human toxicity potential (HTP)

This impact is four times higher for coal (393 g DCB eq./kWh) than for oil (97 g DCB eq./kWh) and nearly nine times greater than for gas power (46 g DCB eq./kWh). The combustion of fuel makes a large contribution for all three options: 82% for gas, 57% for coal and 36% for oil. In the case of coal combustion, the main contributor is the emission of hydrogen fluoride to the air and vanadium and thallium to freshwater from ash. For oil and gas, the emission of polycyclic aromatic hydrocarbons (PAH) is the main contributor to HTP.

3.1.8. Marine aquatic ecotoxicity potential (MAETP)

The MAETP for coal power is estimated at 2407 kg DCB eq./kWh, which is 44 times higher than for oil power (55 kg DCB eq./kWh) and 174 times greater than for gas (14 kg DCB eq./kWh). This is largely due to the combustion of coal (76%), related to air emissions of hydrogen fluoride. The rest of the impact from coal power is attributed to coal extraction, associated with beryllium released to freshwater. On the other hand, the impact from oil and gas power is distributed quite evenly across the life cycle stages, except for the combustion of fuels, which has a negligible contribution.

3.1.9. Ozone layer depletion (ODP)

For this category, oil power has the highest impact (108 µg R11 eq./kWh), which is eight times larger than that of coal (13 µg R11 eq./kWh) and two orders of magnitude worse than for gas (1 µg R11 eq./kWh). Fuel extraction has the highest contribution across the options: 91% for oil, 73% for coal and 45% for gas. Transport is the second most significant stage, with respective contributions of 5%, 22% and 38%. Oil production and transportation involve the use of fire suppressants, such as halon 1301, which is a major contributor in this case. It should be noted, however, that this introduces some uncertainty since the Montreal Protocol covers the use of halons and has led to their elimination in many sectors and regions (UNEP Ozone Secretariat, 2010). However, certain critical uses in the petrochemical industry are granted exemption, thus the actual use of halons will vary from country to country and between businesses. A similar situation applies to the transport of natural gas through long-distance pipeline in which halogenated compounds may be used as coolant for compressors, leading to higher ODP when gas is piped over large distances. In previous years natural gas was supplied in Chile via long-distance pipeline from Argentina and, therefore, potentially incurred high ODP, whereas nowadays gas is just supplied by tanker as LNG. If natural gas supplies once again came from Argentina, the ODP of gas power would increase from 1 µg to 15.2 µg R11 eq./kWh; higher than coal, but still lower than oil. It should also be noted that the ODP of coal power is increased due to the high ODP of petroleum coke, which contributes 4% to the electricity supply in Chile.

3.1.10. Photochemical oxidants creation potential (POCP)

The POCP of electricity from oil and coal is estimated at 420 and 320 mg C₂H₄ eq./kWh, respectively, while for gas power, the impact is equivalent to 83 mg C₂H₂ eq./kWh. Combustion of fuels is the main source, contributing 63% for oil, 70% for coal and 47% for gas power, largely due to NO_x and SO₂ emissions. However, emissions of non-methane volatile organic compounds in diesel engine plants contribute to oil power being the worst option.

3.1.11. Terrestrial ecotoxicity potential (TETP)

Electricity from coal has a TETP of 2.2 g DCB eq./kWh, three times larger than oil (0.8 g) and seven times above gas (0.3 g). Combustion causes 85% of the impact for coal power, while extraction is the main life cycle stage for oil and gas, with a contribution of 47% and 40%, respectively (without the system credits). Another stage with a significant contribution for gas and oil is construction of power plants and fuel reprocessing installations (22% and 25%). Heavy metals released to air are the main burdens across the options. For coal power, heavy metals present in coal are released during its combustion; for oil and gas power, they are emitted in the production of the steel used for infrastructure and machinery. However, recycling of steel and other end-of-life materials has only a small benefit for oil and gas power, reducing the impact by 16% in both options. Coal power is not affected by recycling because the contribution of the construction stage is very small (1%).

3.1.12. Comparison of results with literature

The impacts obtained in this study have been compared to values in literature to validate the results and to identify any differences. As mentioned in the introduction, there are no other studies focusing on fossil-based electricity in Chile. Instead, the comparison here is with the impacts of individual fossil-fuel options estimated for other regions, including European countries, the US, Japan, Mexico and Turkey (Atilgan and Azapagic, 2015; Ecoinvent, 2010; Santoyo-Castelazo et al., 2011; Stamford and Azapagic, 2012). Only those values that have been estimated using the same impact assessment method used in this study (CML) are considered.

As can be seen in Fig. 5, most of the results fall within the ranges found in the literature. An exception is ODP for coal power which is higher than elsewhere. As mentioned earlier, this is related to the high ODP of petroleum coke. On the other hand, the ODP of gas is lower than in the literature. This is due to the absence of long-distance pipelines for the transport of gas and the associated use of halogenated compounds (Schori and Frischknecht, 2012) since Chile uses LNG.

Two other impacts from coal also fall outside the literature ranges – depletion of fossil fuels and elements – both of which are lower than in the literature. This is because coal used in Chile has higher calorific value than elsewhere, together with greater efficiency of power plants and capacity factors (Ecoinvent, 2010).

For oil, HTP, MAETP and TETP are below the literature ranges. This is mainly a result of the higher efficiency of combined cycle power plants, which generate 73% of total power from oil in Chile, while other countries typically use diesel engines which have lower efficiency.

3.2. Change in impacts over time

This section discusses how the impacts of fossil-based electricity generated in the ten-year period from 2004 to 2014 have changed over the years and why. Both per-kWh and total annual impacts are considered. For the base year (2014), these have been estimated based on the impacts per kWh discussed in the previous sections and the contribution of each technology to the total generation (Table 6). For the previous years, the detailed analysis carried out for the base year has not been possible due to a lack of data. Instead, the data used in the base year have been combined with the data in Table 6 to estimate first the impacts of individual technologies and then their total annual impacts based on the amount of electricity they generated in those years.

As shown in Fig. 6, the year 2014 exhibited the highest per-kWh impacts for six and the year 2009 for five impacts. Most of the

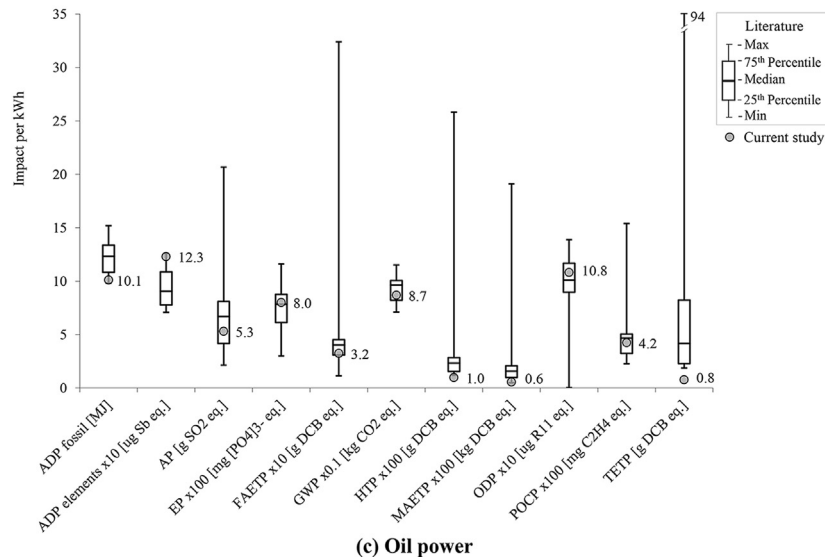
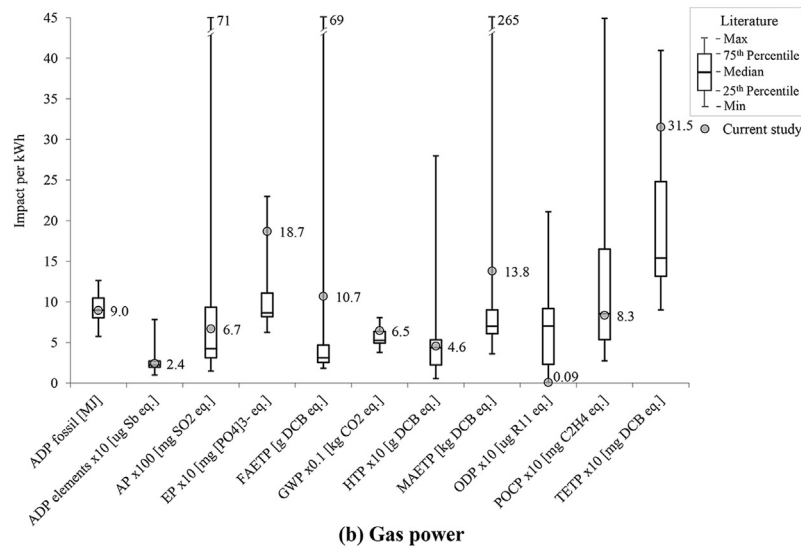
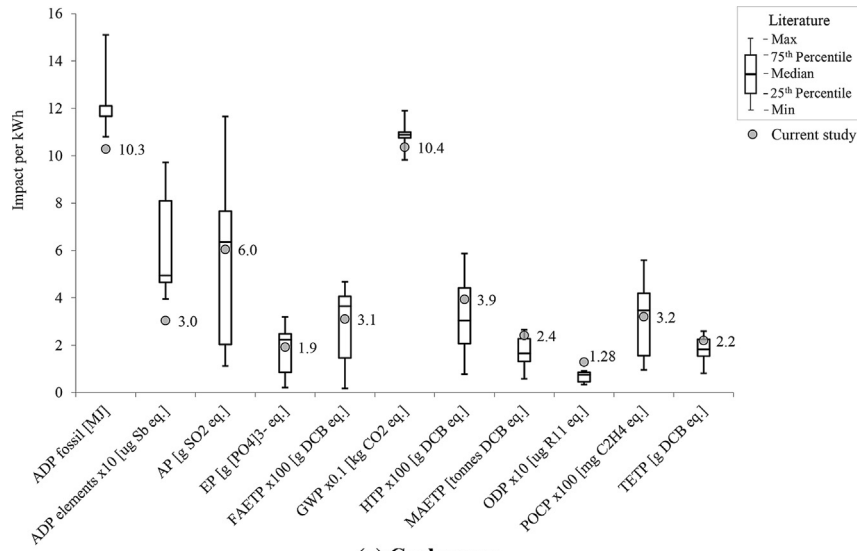


Fig. 5. Comparison of the results from the current study with the literature for coal, gas and oil power. [Literature data sourced from (Atilgan and Azapagic, 2015; Ecoinvent, 2010; Santoyo-Castelazo et al., 2011; Stamford and Azapagic, 2012)]. The results for the current study are for the base year (2014) while the literature data span the period 2004–2014. The capacity factors and efficiencies vary across the literature. For the impacts nomenclature, see Fig. 4].

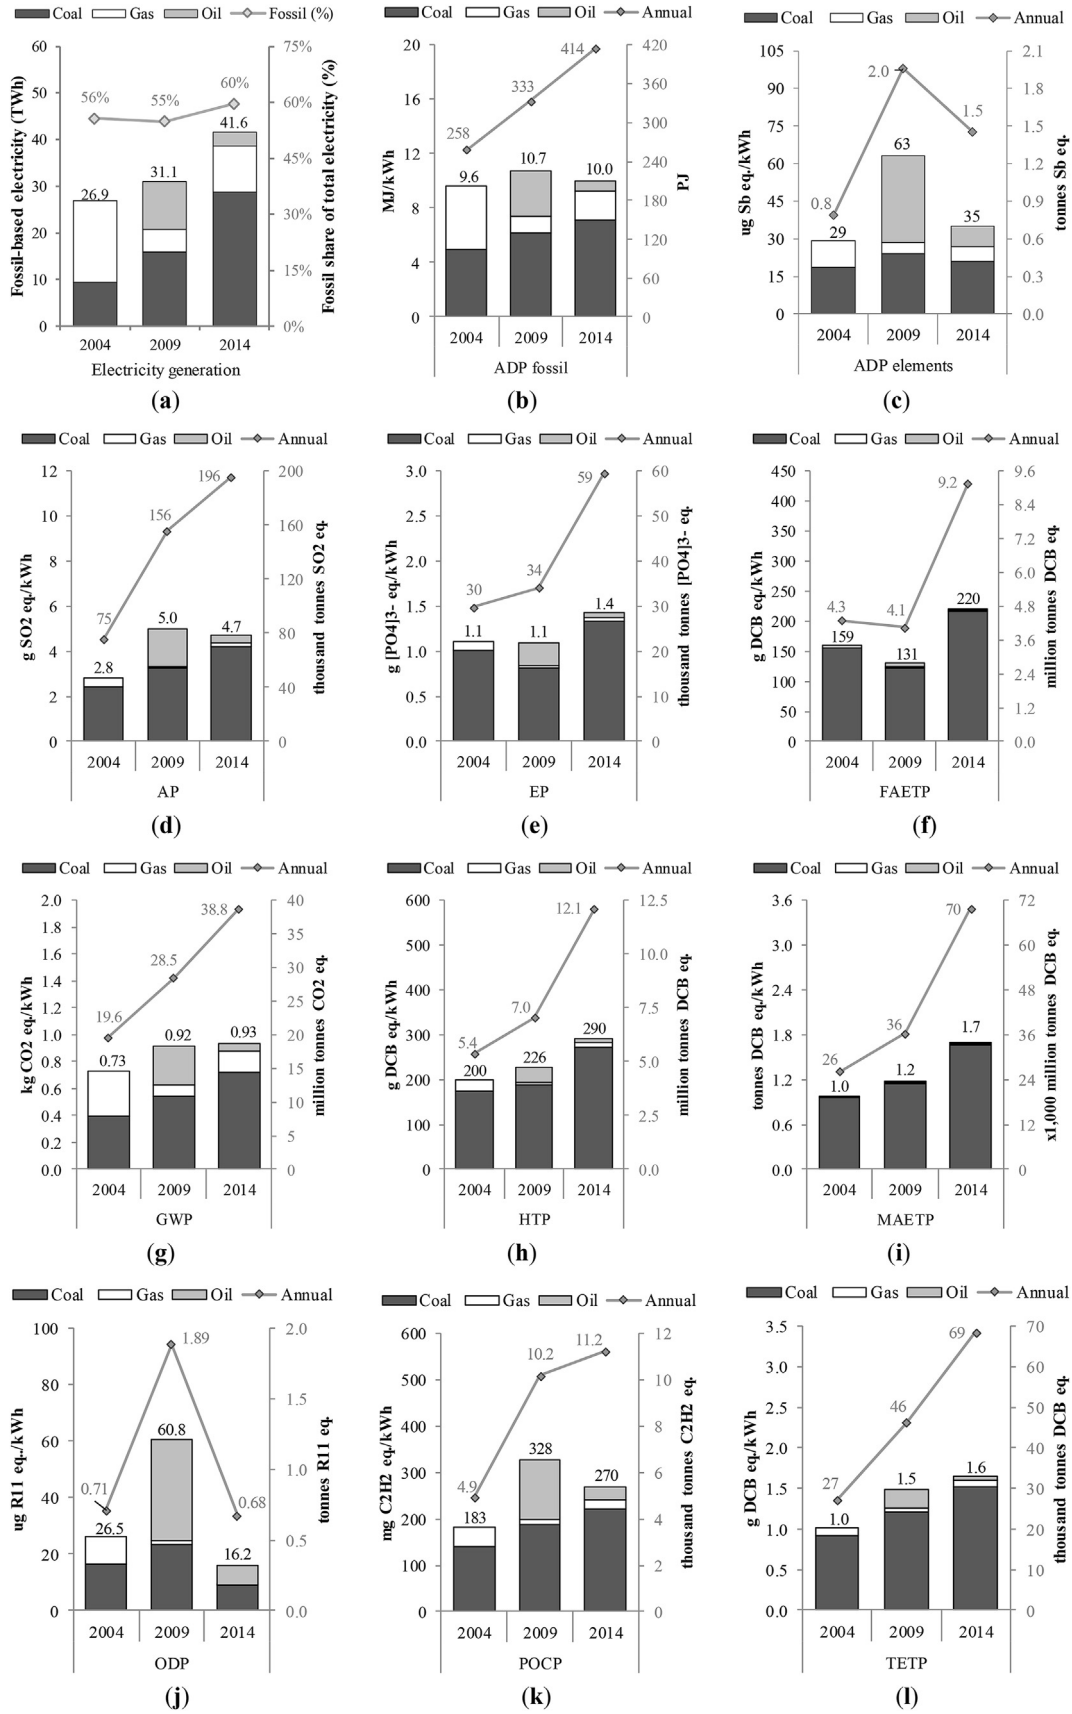


Fig. 6. Environmental impacts of fossil-based electricity in Chile over the period 2004–2014. [For impacts nomenclature, see Fig. 4].

impacts were lowest in 2004. The latter is due to a major contribution (65%) of gas and lower share of coal (35%) than in the other two years. Nonetheless, 32% of coal came from Australia which has a higher FAETP, leading to a worse outcome in 2004 than in 2009 for this indicator. Furthermore, 2004 experienced a peak in gas imports from Argentina, which was transported by long-distance pipelines, causing a higher ODP than in 2014. The subsequent lack of natural gas in 2009 resulted in an increase in oil electricity, together with a slight rise in coal power. Consequently, 2009 saw the highest per-kWh ADP_{fossil}, ADP_{elements}, AP, ODP and POCP. In 2014, coal had a higher contribution than in the previous years, increasing EP, FAETP, GWP, HTP, MAETP and TETP.

Along with the FAETP improvement from 2004 to 2009, as stated above, in the next five-year period (2009–2014), ADP_{elements}, ODP and POCP also decreased per kWh generated (Fig. 6c, j and k). This is due to the reduced contribution of oil power from 33% to 7% over the period. It can be noticed that the first two impacts reduced by a higher rate than POCP because they are several times higher for oil than coal and gas (see sections 3.1.2 and 3.1.9), while this difference in POCP is much lower (section 3.1.10).

In addition to the changes in electricity mix on a year-by-year basis, overall electricity consumption has increased steadily over the decade (CNE, 2015a; Corbo and Hurtado, 2014). This has led to an increase in annual impacts through the years, which can be seen in Fig. 6 for eight impacts (ADP_{fossil}, AP, EP, GWP, HTP, MAETP, POCP and TET). However, for ADP_{elements} and ODP, the year 2009 had the highest impacts per kWh. Hence, despite total generation being higher in 2014, the annual impacts decreased compared to 2009.

Overall, it can be seen that, while electricity generation increased by 55% during the last 10 years, the annual environmental impacts doubled on average in the same period. Only ODP decreased, by around 4%, while the remaining ten impacts increased by between 60% (ADP_{fossil}) and 2.7 times (MAETP); the GWP doubled. It can also be observed from Fig. 6 that the share of coal in the per-kWh impacts grew steadily over the years, in line with its share in the generation.

4. Conclusions

This study has estimated the environmental impacts of the fossil-based electricity generation in Chile and their evolution over a period of ten years, from 2004 to 2014.

Considering individual technologies, the results demonstrate that electricity from gas has the lowest impacts for all 11 impact categories considered. By contrast, coal power shows the worst performance for eight categories, with EP, FAETP and MAETP being between ten and 240 times greater than for gas. The impacts of oil power are typically in between, with three impacts higher than coal (POCP, ADP_{elements} and ODP).

In terms of life cycle stages, operation of power plants is the main hotspot for AP, GWP, HTP, MAETP, POCP and TETP. Extraction

of fuels also plays a major role for ADP_{elements}, ADP_{fossil}, FAETP and ODP. Construction of power plants is significant for ADP_{elements} of oil and gas power, but recycling of copper and steel helps to reduce those impacts by up to 21%. Finally, transport and processing of fuels typically have a minor contribution.

When fossil-fuel electricity mix is considered over the years, six per-kWh impacts were highest in 2014 and five in 2009. Year 2004 had the lowest values for eight impact categories, exceeding 2009 only in EP and FAETP, and 2014 in ODP.

In terms of total annual impacts, an increase in ten environmental impacts can be seen from 2004 to 2014. This deterioration of environmental performance is mostly caused by the rise in the share of coal power, leading on average to the doubling of impacts over the period, despite an increase in electricity demand of only 55%.

The worsening of environmental impacts over time runs contrary to the goals of sustainable development as well as against government targets for reducing GHG emissions by 2030 and should be addressed through appropriate policies. Based on the results of this work, policy in the short-term future should aim to:

- increase the efficiency of all power plants;
- prioritise coal consumption from mines with lower environmental impacts, such as those in South America, and avoid the use of petroleum coke;
- improve measures for emissions control not only for power plants but also across the life cycle, including copper and steel production and ash disposal; and
- displace coal and oil with gas power as soon as possible.

In the medium term to longer terms, it is critical to evaluate and broaden the deployment of renewable power technologies and possibly carbon capture and storage. The potential role of nuclear power could also be explored.

In addition to informing policy and the power industry, this work also fills the LCA data gap with respect to fossil-fuel electricity in Chile, required by LCA practitioners when assessing the environmental impacts of other products and services.

Acknowledgments

The authors thank the Chilean Government for awarding to Carlos Gaete the scholarship “Becas Chile” for his doctoral study at The University of Manchester.

APPENDIX

A1. Data for oil power plants

Table A1
Oil power plants in Chile in the base year.

	Power plant	Type ^a	Emission control systems ^b	Installed capacity (MW)	Electricity in 2014 (GWh)	Share (%)	Efficiency ^c (%)
1.	Gas Atacama 1	CC	LowNOx	389	320	12%	41%
2.	Gas Atacama 2	CC	LowNOx	383	558	20%	42%
3.	San Isidro I	CC	–	379	21	1%	43%
4.	San Isidro II	CC	–	399	39	1%	46%
5.	Nueva Renca	CC	SCR	379	725	26%	46%
6.	Nehuenco I	CC	Wet scrubber	368	233	8%	50%
7.	Nehuenco II	CC	Wet scrubber	398	107	4%	50%
8.	Nehuenco III	OC	Wet scrubber	108	5	<1%	29%
9.	Taltal 1	OC	–	123	7	<1%	31%
10.	Taltal 2	OC	–	122	1	<1%	31%
11.	Candelaria 1	OC	Wet scrubber	136	7	<1%	29%

Table A1 (continued)

	Power plant	Type ^a	Emission control systems ^b	Installed capacity (MW)	Electricity in 2014 (GWh)	Share (%)	Efficiency ^c (%)
12.	Candelaria 2	OC	Wet scrubber	136	6	<1%	29%
13.	Santa Lidia	OC	–	139	<1	<1%	35%
14.	Los Vientos	OC	–	132	10	<1%	
15.	Los Pinos	OC	–	104	130	5%	
16.	Antihue	OC	–	103	60	2%	
17.	Emelda	OC	–	69	<1	<1%	
18.	Colmito	OC	–	58	6	<1%	
19.	Huasco	OC	–	58	1	<1%	
20.	SL de D. de Almagro	OC	–	56	<1	<1%	
21.	D. de Almagro	OC	–	24	<1	<1%	
22.	Yungay 1	OC	–	54	<1	<1%	
23.	Yungay 2	OC	–	54	<1	<1%	
24.	Yungay 4	OC	–	57	<1	<1%	
25.	Coronel	OC	–	47	23	1%	
26.	MIMB	OC	–	29	13	<1%	
27.	San Fco. de Mostazal	OC	–	26	<1	<1%	
28.	CTTO TG1	OC	–	25	2	<1%	
29.	CTTO TG2	OC	–	25	2	<1%	
30.	CTTO TG3	OC	–	38	11	<1%	
31.	TGTAR	OC	–	24	6	<1%	
32.	El Salvador	OC	–	24	<1	<1%	
33.	TGIQ	OC	–	24	6	<1%	
34.	Colihues	OC	–	22	32	1%	
35.	Punta Colorada	OC	–	17	23	1%	
36.	Cem Bio Bio	OC	–	14	27	1%	
37.	Los Espinos	DE	–	124	45	2%	36%
38.	Olivos	DE	–	115	7	<1%	
39.	SUTA	DE	–	104	173	6%	
40.	El Peñón	DE	–	90	64	2%	
41.	Termopacífico	DE	–	81	3	<1%	
42.	Trapén	DE	–	81	26	1%	
43.	Teno	DE	–	59	12	<1%	
44.	Degañ	DE	–	36	<1	<1%	
45.	Chuyaca	DE	–	15	2	<1%	
46.	CalleCalle	DE	–	13	3	<1%	
47.	Constitución	DE	–	9	2	<1%	
48.	GMAR	DE	–	8	7	<1%	
49.	Quellón II	DE	–	8	2	<1%	
50.	INACAL	DE	–	7	8	<1%	
51.	Maule	DE	–	6	1	<1%	
52.	ZOFRI_2-5	DE	–	5	3	<1%	
53.	ZOFRI_7-12	DE	–	5	4	<1%	
54.	SUIQ	DE	–	4	2	<1%	
55.	Lebu	DE	–	4	<1	<1%	
56.	Cañete	DE	–	3	<1	<1%	
57.	El Totoral	DE	–	3	<1	<1%	
58.	Estancilla	DE	–	3	<1	<1%	
59.	Placilla	DE	–	3	<1	<1%	
60.	Quintay	DE	–	3	<1	<1%	
61.	Curacautín	DE	–	3	1	<1%	
62.	Curama	DE	–	3	<1	<1%	
63.	Eagon	DE	–	2	1	<1%	
64.	Trongol-Curanilahue	DE	–	2	<1	<1%	
65.	Concón	DE	–	2	<1	<1%	
66.	Las Vegas	DE	–	2	<1	<1%	
67.	Lonquimay	DE	–	2	<1	<1%	
68.	Los Sauces I	DE	–	2	1	<1%	
69.	Los Sauces II	DE	–	2	<1	<1%	
70.	Contulmo	DE	–	1	<1	<1%	
71.	San Gregorio	DE	–	1	<1	<1%	

^a CC: Combined cycle, OC: Open cycle, DE: Diesel engine.

^b Wet scrubber: desulphurisation system; LowNOx: Low NOx burner; SCR: Selective catalytic reduction. ^cEfficiency of OC plants no. 13–36 and DE no. 37–71 determined from electricity produced and fuel consumed.

A2. Estimation of capacity factors and environmental burdens

The capacity factors are estimated as follows:

$$CF_{actual} = \frac{E}{8760 P} \quad (A1)$$

where:

CF_{actual} : capacity factor of a plant of interest (–)

E : electricity generated per year $\left(\frac{MWh}{yr}\right)$

P : installed capacity (MW)

8760: number of hours in a year.

The infrastructure-related environmental burdens of each plant are then estimated based on the burdens of the reference plant in

Ecoinvent (400 MW) as follows:

$$B_{actual} = \frac{B_{ref}}{8760 P_{ref} CF_{actual} L_{actual}} \left(\frac{\text{unit}}{\text{MWh}} \right)$$

where:

- B_{actual} environmental burden of a power plant of interest (burden/unit)
- B_{ref} environmental burden of a reference power plant in Ecoinvent (burden/unit)
- P_{ref} installed capacity of the Ecoinvent reference power plant (MW)
- CF_{actual} capacity factor of a power plant of interest (–)
- L_{actual} lifespan of a power plant of interest (yr).

References

- Atilgan, B., Azapagic, A., 2015. Life cycle environmental impacts of electricity from fossil fuels in Turkey. *J. Clean. Prod.* 106, 555–564. <https://doi.org/10.1016/j.jclepro.2014.07.046>.
- Bartos, J., Robertson, A., 2014. Energy supply Security: Emergency Response of IEA countries. *Int. Energy Agency* 606.
- Bronfman, N.C., Jiménez, R.B., Arévalo, P.C., Cifuentes, L.A., 2012. Understanding social acceptance of electricity generation sources. *Energy Policy* 46, 246–252. <https://doi.org/10.1016/j.enpol.2012.03.057>.
- CISEN, 2016. Updated database [WWW Document]. *Indep. Coord. Natl. Electr. Syst.* <https://www.coordinador.cl/informes-y-documentos/>. accessed 5.5.16.
- CNE, 2015a. Database of electricity generation in Chile [WWW Document]. *Natl. Energy Comm. Chile.* <https://www.cne.cl/estadisticas/electricidad/>. accessed 5.5.15.
- CNE, 2015b. Installed capacity in the SIC and SING [WWW Document]. *Natl. Energy Comm. Chile.* <https://www.cne.cl/estadisticas>. accessed 7.6.15.
- CNE, 2015c. Hydrocarbons - Imports [WWW Document]. *Natl. Energy Comm. Chile.* <https://www.cne.cl/estadisticas/hidrocarburo/>. accessed 5.1.15.
- CNE, 2015d. Short-term nodal electricity price of the central interconnected electricity system - Final report (Fijación de precio de nudo de corto plazo del sistema interconectado central - Informe técnico definitivo), National Energy Commission of Chile (Spanish).
- CNE, 2015e. Short-term nodal electricity price of the interconnected electricity system of Norte Grande - Final report (Fijación de precio de nudo de corto plazo del sistema interconectado del Norte Grande - Informe técnico definitivo), National Energy Commission of Chile (Spanish).
- CNE, 2015f. Series of Average Market Price of the Interconnected Systems (Serie de Precio Medio de Mercado de Sistemas Interconectados). National Energy Commission of Chile, In Spanish.
- CONAMA, 2010. First report of solid waste management in Chile (Primer reporte del manejo de residuos sólidos en Chile), Comisión Nacional del Medio Ambiente de Chile (In Spanish).
- Corbo, V., Hurtado, A., 2014. Causes and consequences of the energy problem in Chile: A vision from the macroeconomy (Causas y consecuencias del problema energético en Chile: Una visión desde la macroeconomía). *Puntos de Referencia - Centro de estudios publicos*, Spanish.
- Dones, R., Bauer, C., Röder, A., 2007. Coal (Kohle). In: Dones, R., Bauer, C., Röder, A. (Eds.), *Life Cycle Inventories of Energy Systems*, Ecoinvent Report No. 6. Swiss Centre for Life Cycle Inventories. German, Dübendorf, CH.
- Ecoinvent, 2010. Ecoinvent V2.2 database. Swiss Centre for Life cycle Inventories [WWW Document]. <https://www.ecoinvent.org/>.
- ENAP, 2015. Annual Report 2014 (Memoria Anual 2014). *Empresa Nacional del Petroleo*, Spanish.
- Gaete-Morales, C., Gallego-Schmid, A., Stamford, L., Azapagic, A., 2018. Assessing the environmental sustainability of electricity generation in Chile. *Sci. Total Environ.* 636, 1155–1170. <https://doi.org/10.1016/j.scitotenv.2018.04.346>.
- Garcia, R., Marques, P., Freire, F., 2014. Life-cycle assessment of electricity in Portugal. *Appl. Energy* 134, 563–572. <https://doi.org/10.1016/j.apenergy.2014.08.067>.
- Guinée, J.B., Gorree, M., Heijungs, R., Huppes, G., Kleijn, R., de Koning, A., van Oers, L., 2002. Handbook on Life Cycle Assessment, Operational Guide to the ISO Standards. Ministry of Housing, Spatial Planning and Environment (VROM) and Centre of Environmental Science (CML). The Hague and Leiden, The Netherlands. <https://doi.org/10.1007/0-306-48055-7>.
- Hackley, P.C., Warwick, P., Alfaro, G., Cuebas, R., 2006. World coal quality inventory : Chile. In: Karlsen, A.W., Tewalt, S.J., Bragg, L.J., Finkelman, R.B. (Eds.), *World Coal Quality Inventory: South America*. U.S.Geological Survey, Fresno, California, p. 1241.
- International Energy Agency, 2014. Key World Energy Statistics 2014, Statistics. <https://doi.org/10.1787/9789264039537-en>.
- International Energy Agency, 2012. Oil and Gas Security Chile 2012. International Energy Agency. <https://doi.org/10.3366/saj.2004.26.1-2.vi>.
- International Energy Agency, 2009. Chile Energy Policy Review.
- International Group of Liquefied Natural Gas Importers, 2015. The LNG Industry in 2014.
- International Institute for Sustainability Analysis and Strategy, 2015. Global Emissions Model for Integrated Systems (GEMIS).
- International Organization for Standardization, 2006a. ISO 14040 - Environmental Management - Life Cycle Assessment - Principles and Framework (Geneva, Switzerland).
- International Organization for Standardization, 2006b. ISO 14044 - Environmental Management - Life Cycle Assessment - Requirements and Guidelines (Geneva, Switzerland).
- Jungbluth, N., 2007. Crude oil (Erdöl). In: Dones, R. (Ed.), *Life Cycle Inventories of Energy Systems*, Ecoinvent Report No. 6. Swiss Centre for Life Cycle Inventories (Dübendorf, CH).
- Ministry of Energy of Chile, 2015. Non-Conventional Renewable Energy Summary Report 2014 (Reporte ERNC resumen 2014). In Spanish.
- Ministry of Energy of Chile, 2014a. Energy Balance of Chile.
- Ministry of Energy of Chile, 2014b. Energy agenda: A challenge for the country, progress for everyone.
- Ministry of Energy of Chile, 2013. Law 20698, Chile.
- Ministry of Environment of Chile, 2015. Intended Nationally Determined Contribution (INDC) of Chile: towards the Climate Agreement of (Paris).
- Ministry of Environment of Chile, 2014. Chile's First Biennial Update Report. Executive Summary.
- PE International, 2013. Life Cycle Assessment Software (GaBi) Version 6.
- Platts McGraw Hill Financial, 2015. Portworld distance calculator [WWW Document]. URL <http://www.portworld.com/map>. accessed 5.1.15.
- PRIEN-UTFSM, 2008. Potential contribution of non-conventional renewable energy and energy efficiency to the electricity mix 2008–2025 (Aporte potencial de energías renovables no convencionales y eficiencia energética a la matriz eléctrica 2008 - 2025). In Spanish.
- Raineri, R., 2006. Chile. Where it all started. In: Sioshansi, F.P., Pfaffenberger, W. (Eds.), *Electricity Market Reform*. Elsevier, UK, pp. 77–108. <https://doi.org/10.1016/B978-008045030-8/50005-9>.
- Santana, C., Falvey, M., Ibarra, M., García, M., 2014. Renewable energy in Chile. The power potential of wind, solar and hydropower from Arica to Chiloé (Energías renovables en Chile. El potencial eólico, solar e hidroeléctrico de Arica a Chiloé). Ministry of Energy of Chile, Santiago, Chile (In Spanish).
- Santoyo-Castelazo, E., Gujba, H., Azapagic, A., 2011. Life cycle assessment of electricity generation in Mexico. *Energy* 36, 1488–1499. <https://doi.org/10.1016/j.energy.2011.01.018>.
- Schori, S., Frischknecht, R., 2012. Life cycle inventory of natural gas supply. *ESU-Services fair Consult*. Sustain.
- SEA, 2015. Environmental impact assessment system (Sistema de evaluación de impacto ambiental) [WWW Document]. *Environ. Eval. Serv.* URL <http://www.sea.gob.cl/> (accessed 12.3.16). In Spanish.
- SEA, 2011. Mina Invierno - Coal Mine Environmental Impact Study. Environmental Evaluation Service.
- Sims, D., 2011. Chile's Clean Energy Future. Natural Resources Defense Council.
- SMA, 2015. Data Record of Emissions and Fuel Composition for Chilean Thermal Power Plants. Environmental Protection Agency of Chile, Santiago, Chile.
- Spielmann, M., Bauer, C., Dones, R., Tuchschnid, M., 2007. Transport Services, Ecoinvent Report No. 14. Swiss Centre for Life Cycle Inventories. CH, Dübendorf.
- Stamford, L., Azapagic, A., 2012. Life cycle sustainability assessment of electricity options for the UK. *Int. J. Energy Res.* 36, 1263–1290. <https://doi.org/10.1002/er.2962>.
- Superintendencia de Electricidad y Combustibles de Chile, 2014. Fuels Statistic Report 2014 Chile (Informe estadístico de combustibles 2014 Chile) (Spanish).
- UN Intergovernmental Panel on Climate Change, 2007. Mitigation of Climate Change: Contribution of Working Group III to the Fourth Assessment Report of the Intergovernmental Panel on Climate Change, Intergovernmental Panel on Climate Change.
- UNEP Ozone Secretariat, 2010. Handbook for the Montreal Protocol on Substances that Deplete the Ozone Layer, the Montreal Protocol, Summary of Control Measures under the Montreal Protocol, Annex A - Group II: Halons (Halon 1211, Halon 1301 and Halon 2402).
- Vega-Coloma, M., Zaror, C.A., 2018. Environmental impact profile of electricity generation in Chile: a baseline study over two decades. *Renew. Sustain. Energy Rev.* 94, 154–167. <https://doi.org/10.1016/j.rser.2018.05.058>.